


1-1/2" AND LARGER METER, BY-PASS AND VAULT WITH BACKFLOW PROTECTION

METER VAULT DIMENSIONS (INSIDE)		
METER SIZE	WIDTH (MIN.)	LENGTH (MIN.)
2" & SMALLER	5' - 0"	6' - 0"
3" & 4"	6' - 0"	8' - 0"
6" & LARGER	CONTACT WATER DEPT.	

NOTE: METER VAULT SHALL BE LOCATED IN A NON-TRAFFIC AREA.

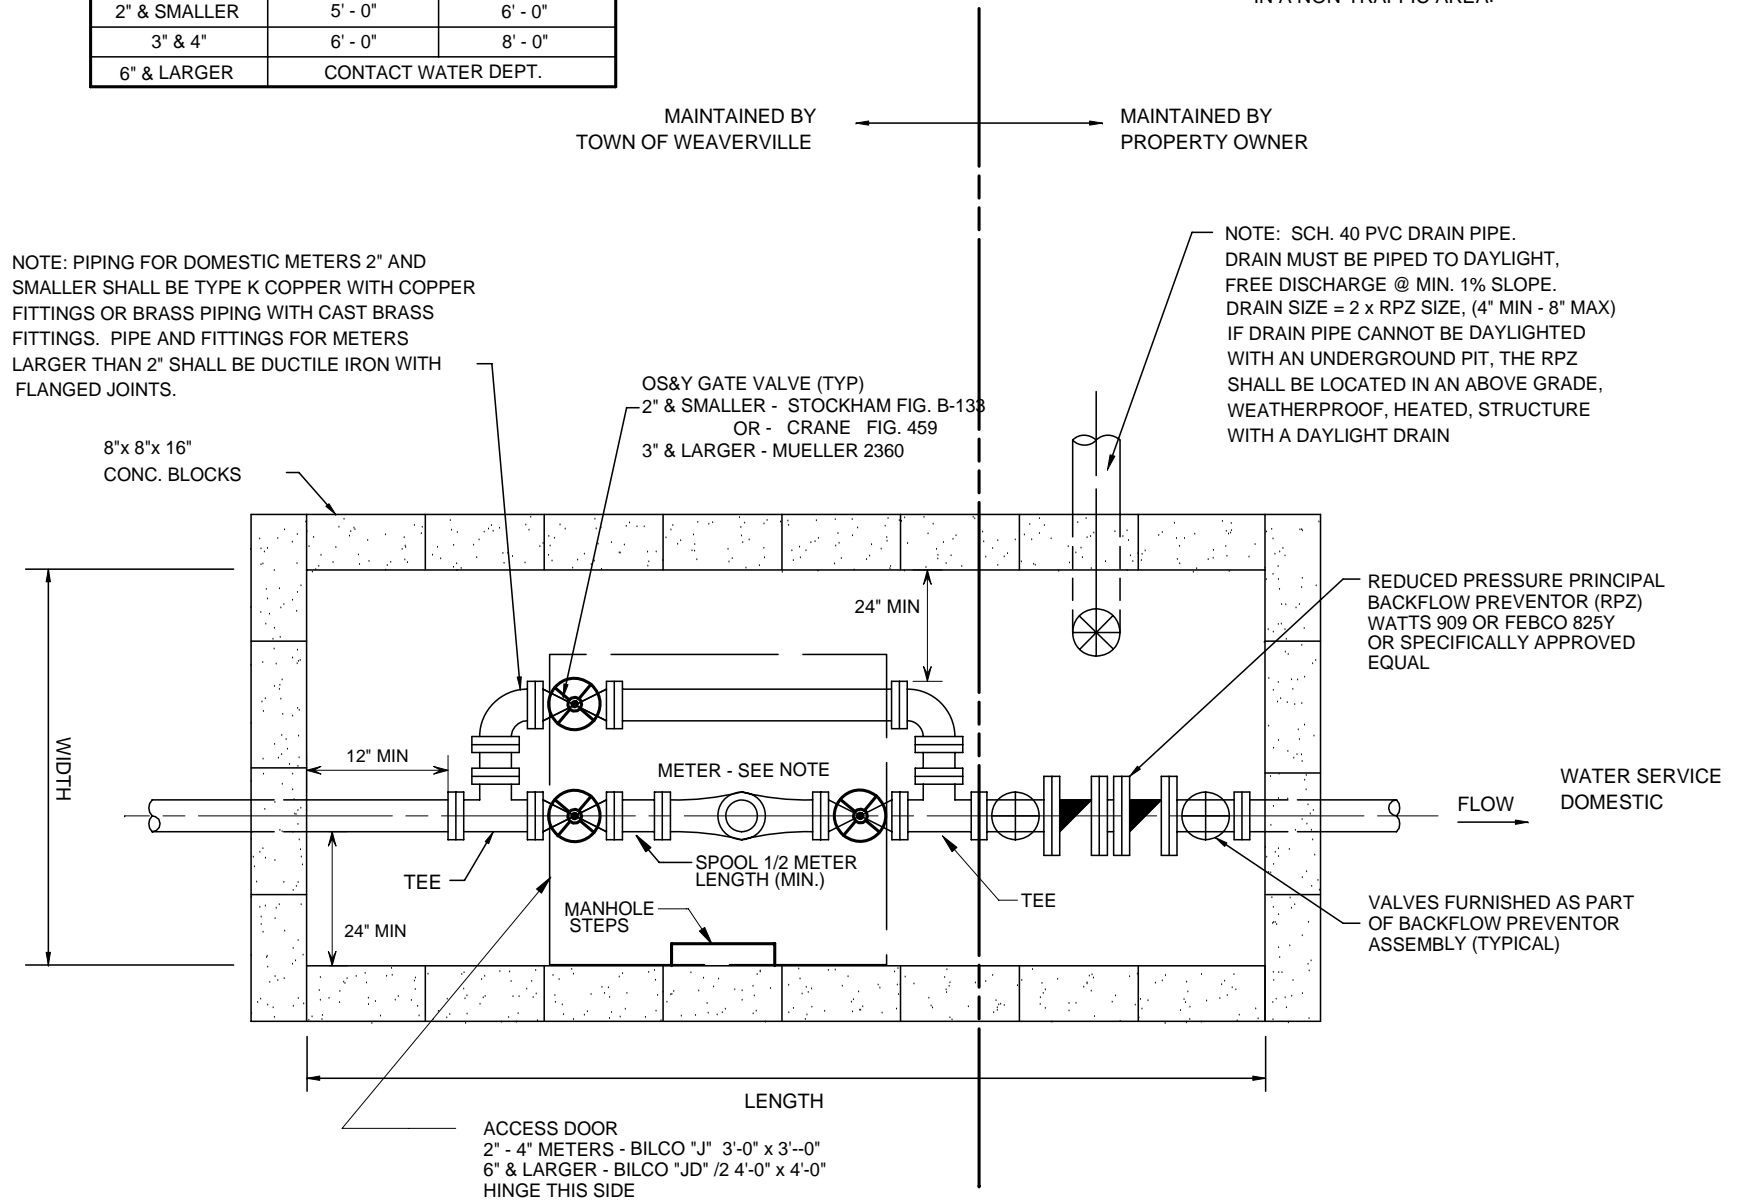

NOTE:
METER SHALL BE AS FOLLOWS:
AS SPECIFICALLY SPECIFIED
BY THE TOWN FOR THE
SPECIFIC APPLICATION