


PLAN

NOTES

- 1- TAPPING SLEEVE SHALL BE MUELLER NO. H-615 OR APPROVED EQUAL.
- 2- TAPPING VALVE SHALL BE MUELLER NO. T-2360 OR APPROVED EQUAL.
- 3- SOLID CONCRETE OR BRICK BLOCKING SHALL BE USED AS FOOTING FOR DUCTILE IRON. PIPE. PVC PIPE SHALL REQUIRE A 3000 PSI FOOTING.
- 4- CONCRETE SHALL NOT CONTACT BOLTS OR ENDS OF MACHANICAL JOINT FITTINGS.
- 5- SEE APPROPRIATE STANDARD DETAIL FOR THRUST BLOCK DIMENSIONS AND VALVE BOXES.

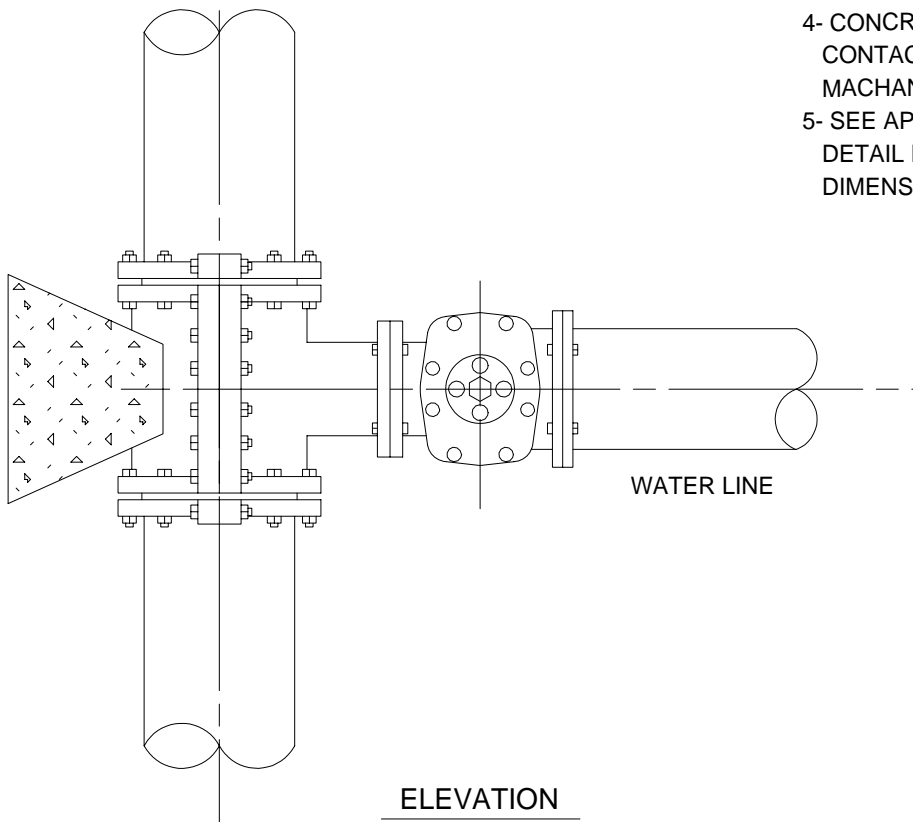

ELEVATION

**TAPPING SLEEVE AND VALVE INSTALLATION**